**ENGINEERING STANDARD**

DATE EFFECTIVE

4-1-86

NUMBER

EST 1336

**ENGINEERING DESIGN
SPECIFICATION**

DATE REVISED

PAGE

1 of 3

MODEL 4406**ACOUSTIC & ELECTRICAL SPECIFICATIONS**

Power Test:	25 V IEC shaped noise, 2 hours
Rated Impedance:	6 ohm
Minimum Impedance:	5.1 ohm
Impedance Curve:	See page 2
Frequency Response (-6 dB):	50 Hz to 27 kHz (half space)
Distortion:	See page 3
Sensitivity:	87 dB for 2.83 V @ 1m
Crossover Frequency:	3000 Hz


PHYSICAL SPECIFICATIONS

Enclosure Volume:	.42 cu. ft.
Enclosure Dimensions:	15.38 x 9.38 x 8.63 D (inch)


SYSTEM COMPONENTS

Cabinet:	C4406
Grille:	G4406
Bass Transducer:	115H-1
High Frequency Transducer:	Q35Ti
Crossover Network:	N4406

Design Engineer Greg Timba



Brüel & Kjær

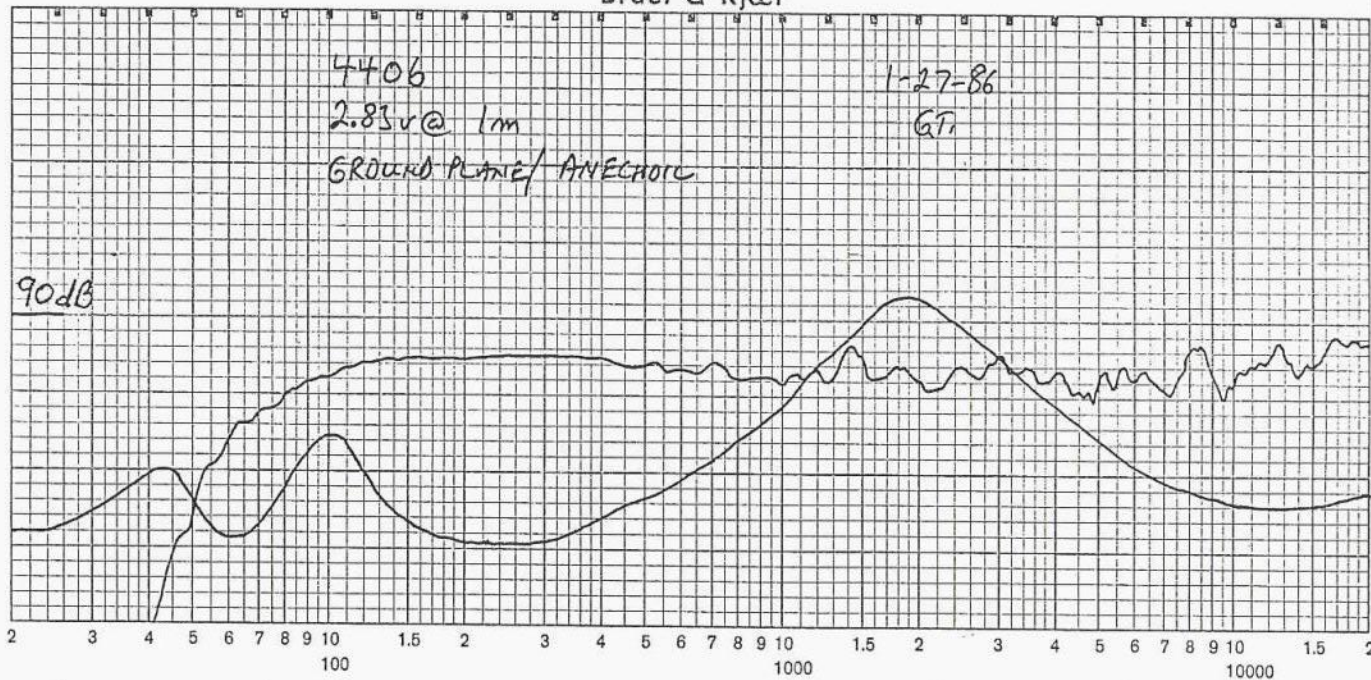

ENGINEERING DESIGN
SPECIFICATION

ENGINEERING STANDARD

DATE REVISED


DATE EFFECTIVE
4-1-86

PAGE
2 of 3

NUMBER
EST 1336



Brüel & Kjær

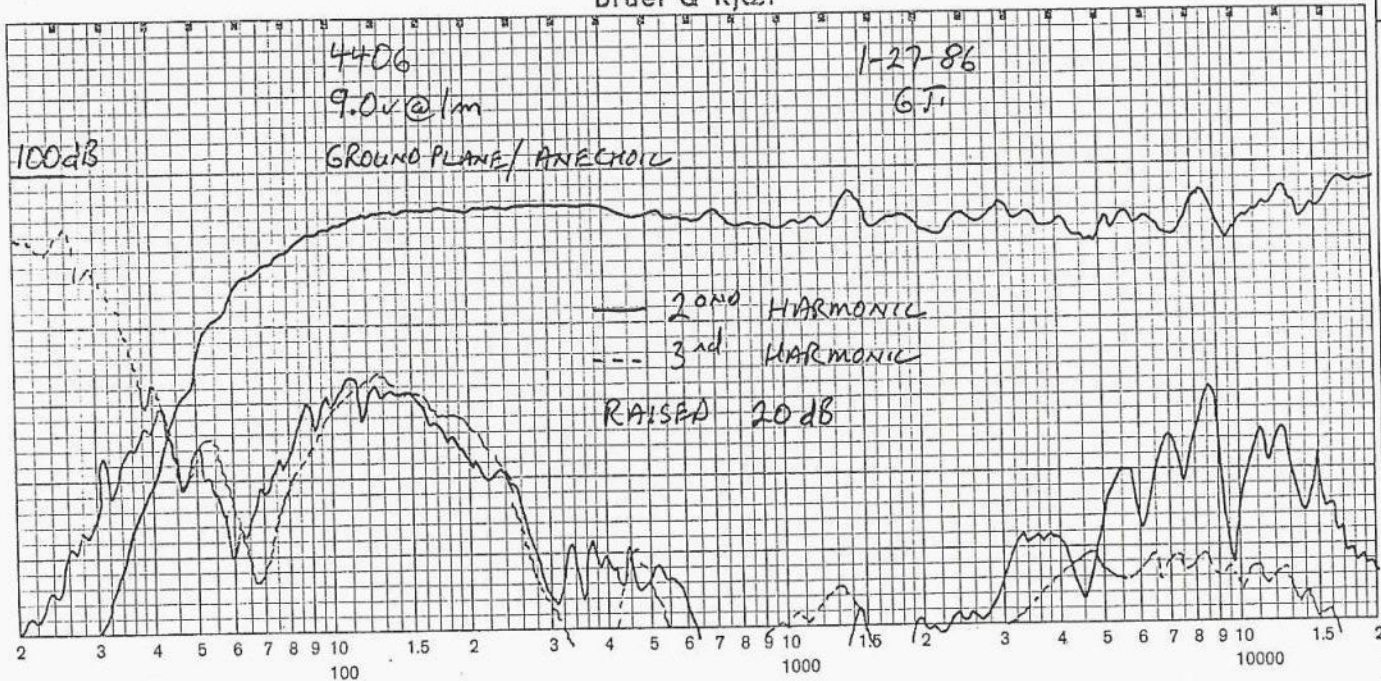

ENGINEERING DESIGN
SPECIFICATION

ENGINEERING STANDARD

DATE REVISED

DATE EFFECTIVE
4-1-86

PAGE
3 OF 3

NUMBER
EST 1336

MODEL N4406


2 - WAY PASSIVE CROSSOVER

Crossover Frequency: 3000 Hz
 Crossover Slopes: 12 dB/ Octave
 Voltage Drive: See Curve

Design Engineer Greg Timken



Brüel & Kjaer

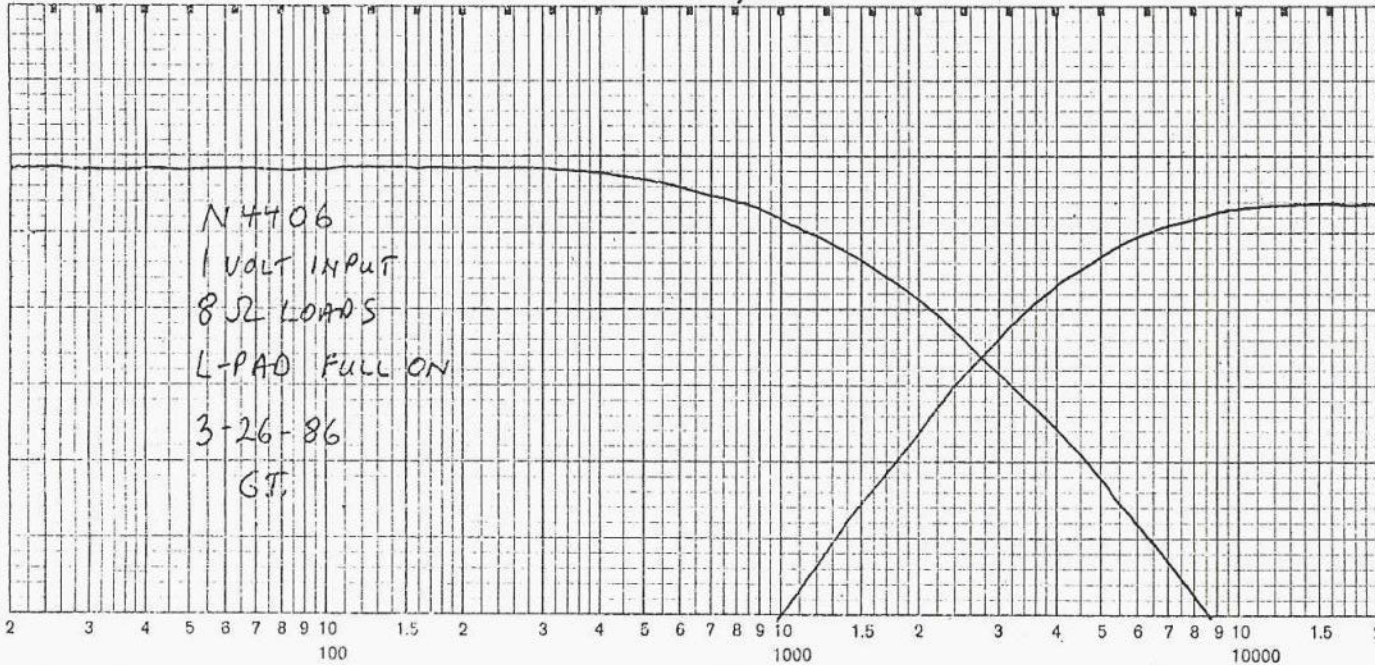

ENGINEERING DESIGN SPECIFICATION	ENGINEERING STANDARD	DATE EFFECTIVE	NUMBER
		4-1-86	EST 1340
		DATE REVISED	PAGE
			1 OF 1