


# SPECIFICATIONS

## RA-54

### Reverberation time

|                            |                                                            |
|----------------------------|------------------------------------------------------------|
| Reverberating time.....    | 0—2.5 sec. (Effect 1)                                      |
| Delay time.....            | 30—80 msec. (Effect 2)                                     |
| Frequency response.....    | 10 Hz—35 kHz, +0 dB, -0.5 dB                               |
| Harmonic distortion .....  | Less than 0.01% (20 Hz—20 kHz, output 1 V)                 |
| S/N ratio.....             | 100 dB (Short-circuited IHF-A network)                     |
| Maximum output.....        | 7 V (1 kHz, THD 0.01%, RL47 k $\Omega$ )                   |
| Gain .....                 | 0 dB                                                       |
| Input impedance.....       | 47 k $\Omega$                                              |
| Output impedance .....     | 600 $\Omega$                                               |
| Mic input sensitivity..... | 1 mV                                                       |
| Mic input impedance .....  | 36 k $\Omega$                                              |
| Attenuation.....           | -6 dB at 1 kHz                                             |
| Input sensitivity .....    | 150 mV                                                     |
| Power consumption.....     | 18 W                                                       |
| Dimensions.....            | 420(W) x 57(H) x 216(D) mm (16-17/32" x 2-13/64" x 8-1/2") |
| Weight (net) .....         | 2.5 kg (5.5 lb)                                            |

(W02-0586-08)

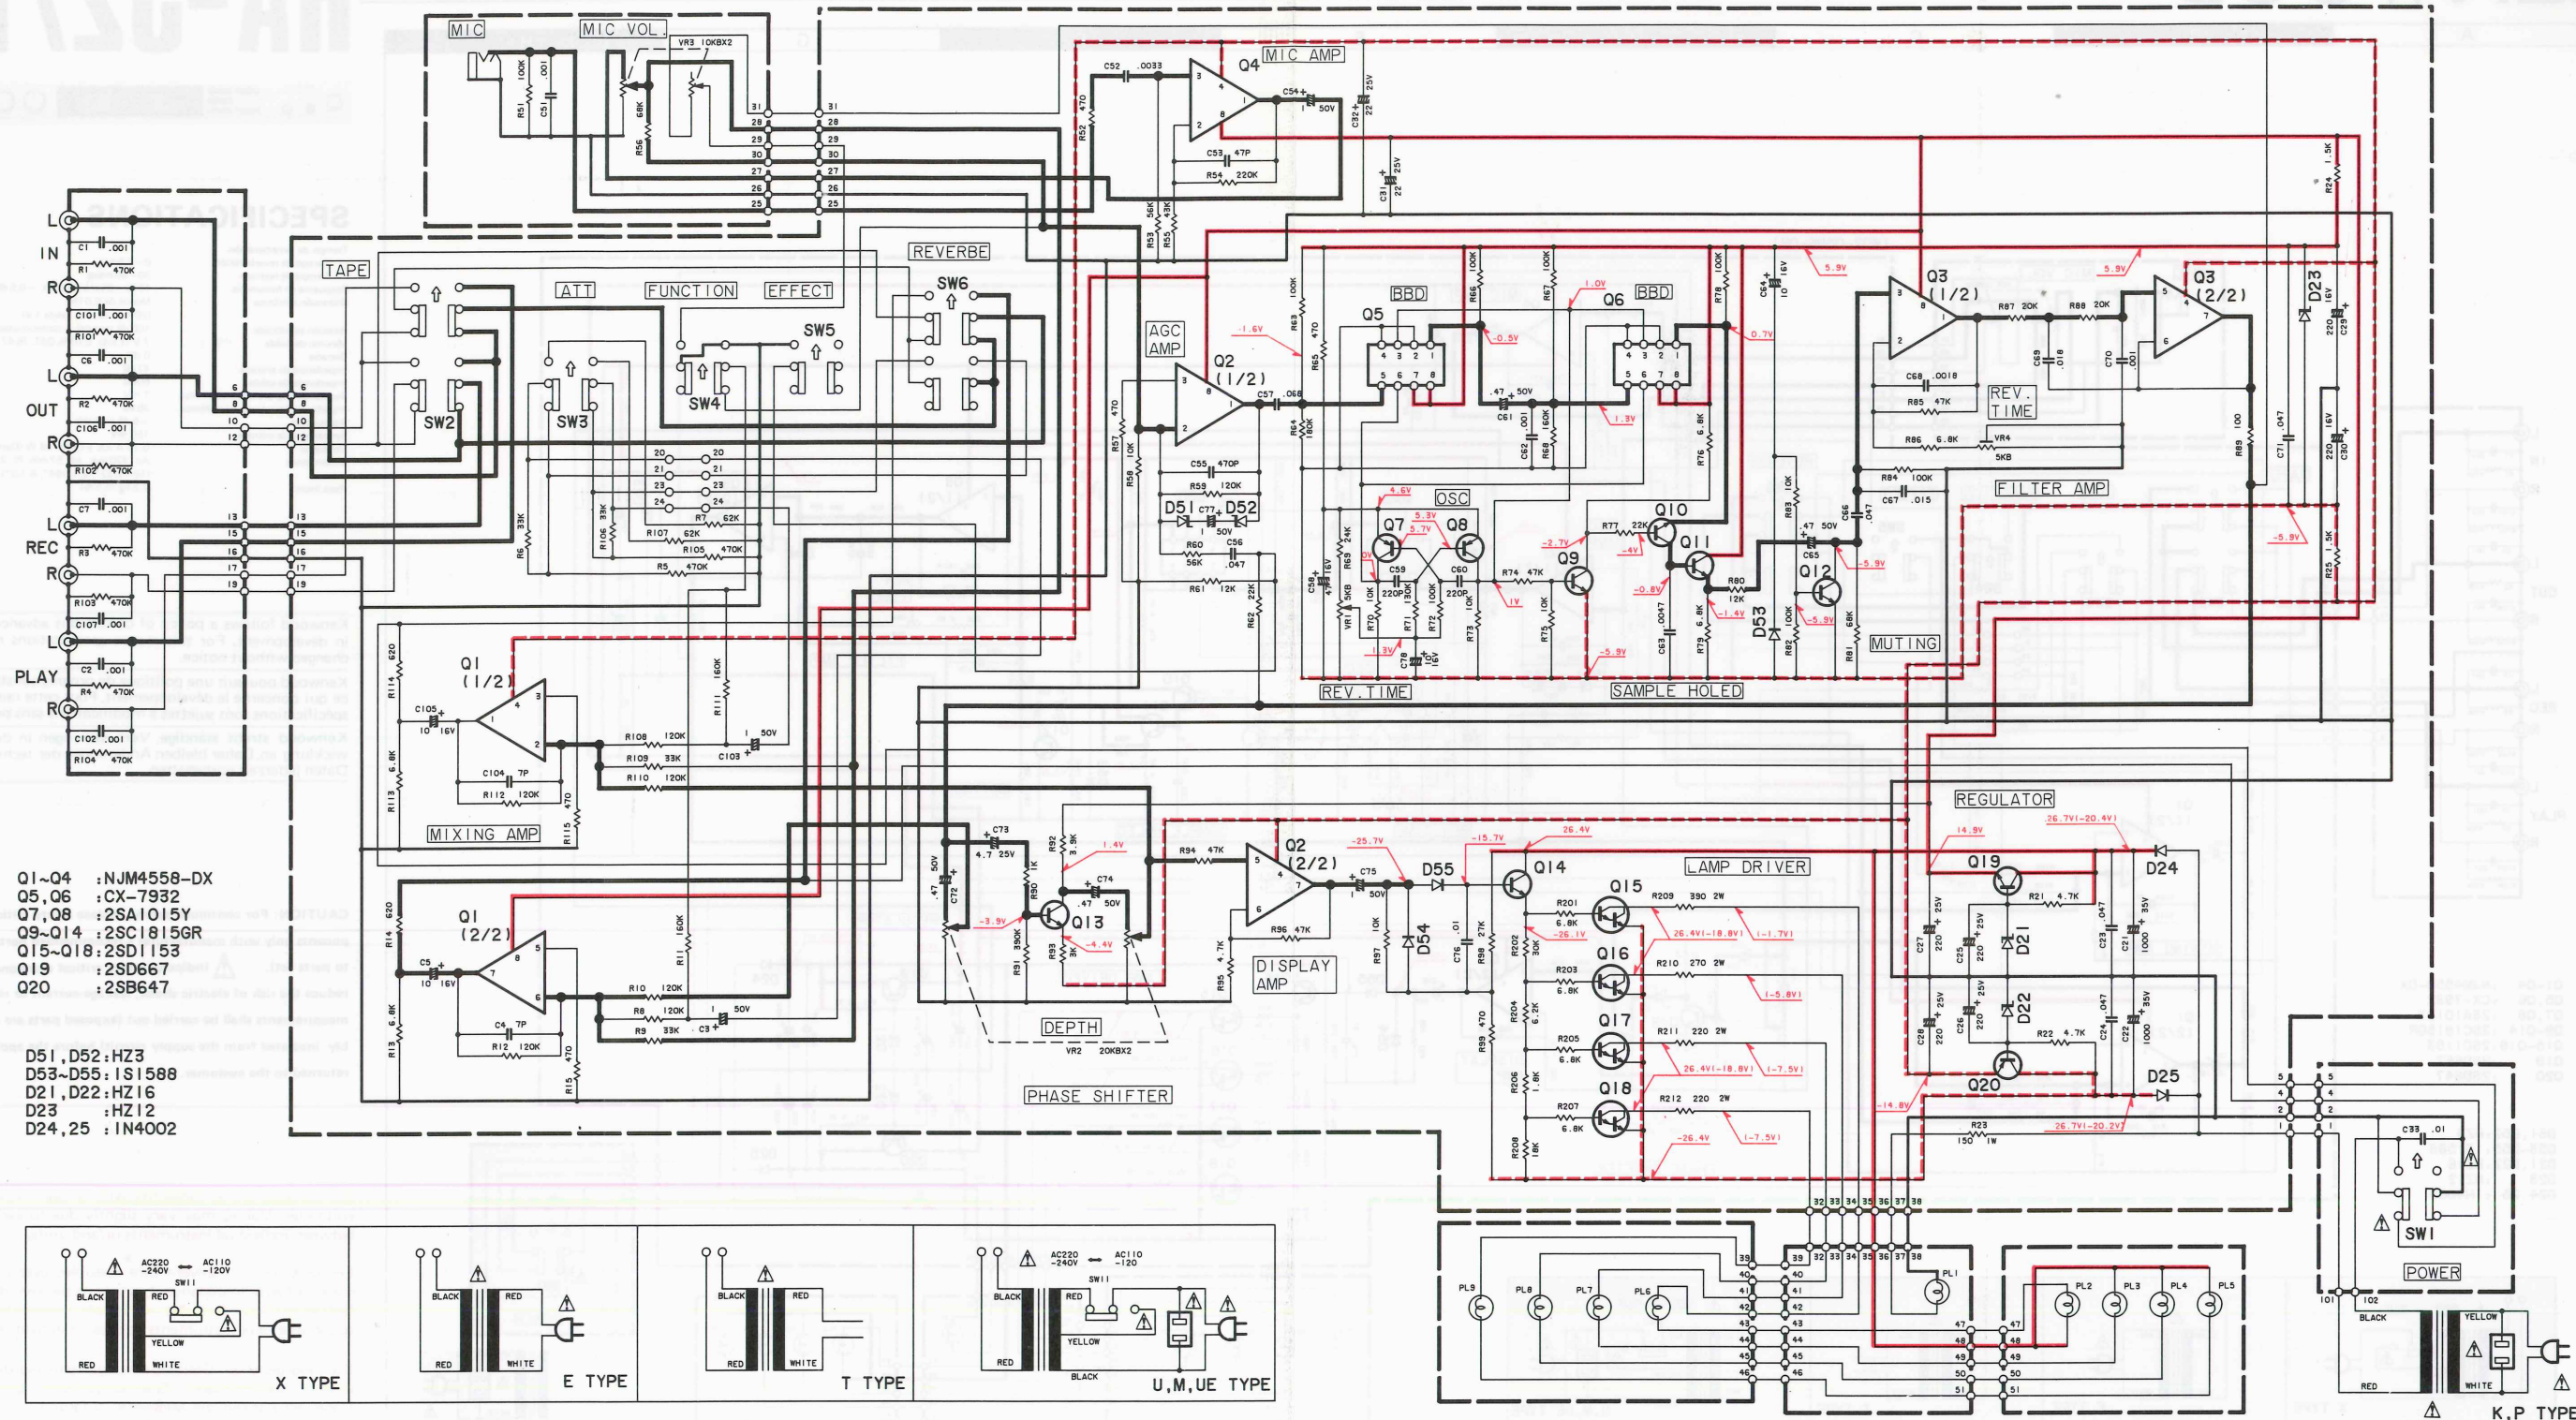

CAUTION: For continued safety, replace safety critical components only with manufacturer's recommended parts (refer to parts list). ⚠ Indicates safety critical components. To reduce the risk of electric shock, leakage-current or resistance measurements shall be carried out (exposed parts are acceptably insulated from the supply circuit) before the appliance is returned to the customer.

DC voltages are as measured with a high impedance voltmeter. Values may vary slightly due to variations between individual instruments or/and units.

Les tensions c.c. doivent être mesurées avec un voltmètre à haute impédance. Les valeurs peuvent différer légèrement du fait des variations inhérentes aux appareils et aux instruments de mesure individuels.

Die angegebenen Gleichspannungswerte wurden mit einem hochohmigen Spannungsmesser gemessen. Dabei schwanken die Meßwerte aufgrund von Unterschieden zwischen einzelnen Instrumenten oder Geräten u.U. geringfügig.

RA-54

KENWOOD